

Questionnaire for Earthing Lances

To prepare an offer, please fill in this questionnaire as detailed as possible and return by fax, post or e-mail.

Fax +49 89 / 4 36 04 73

Post ARCUS ELEKTROTECHNIK Alois Schiffmann GmbH • Truderinger Straße 199 • 81673 Munich/Germany

E-mail info@arcus-schiffmann.com

Contact Information

Last name	First name
Company	Department
Street, number	Zip code, town
Phone	Fax
E-mail	Web

Earthing point

Name / Location of the substation	
Nominal voltage [kV]	
Rated short-circuit current / Rated time [kA/s]	
Conductor distance [mm]	
Details of conductor (-bundle)	
Type (line, tube)	
Material (Al, Cu)	
Dimensions (diameter)	
Centre spacing between bundle conductors	

Earthing point (continued)





Conductor height [mm] *

Height of the earthed support [mm] *

Are the supports accessible from all sides?

Type of support (A/B/C/D)

*Refer to the upper edge of the ground level, please (GOK)

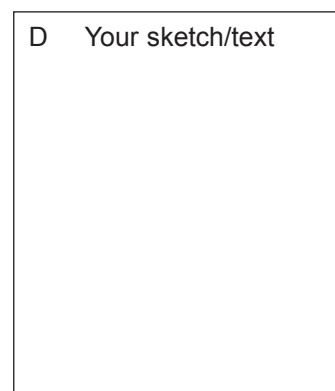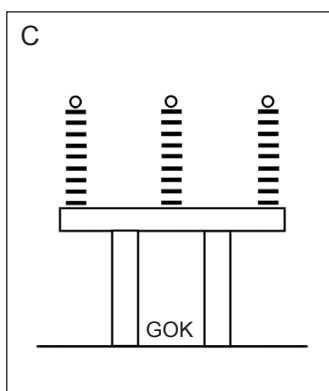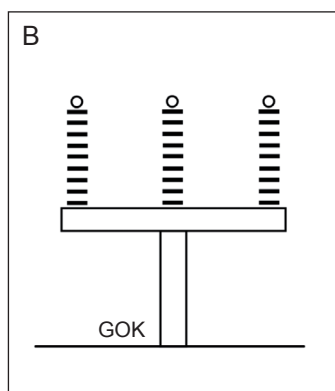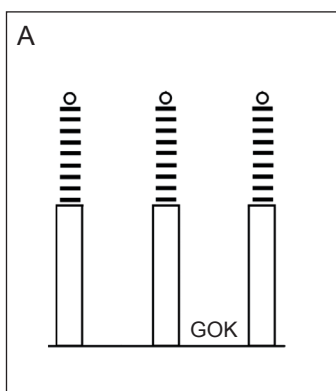

Others

Required quantity	Required delivery time
Language of documentation	Others

I agree that my data will be permanently saved for contacting and queries.

Date

Signature